

# Syphilis Test Menu

## Recommended Testing

Test Name	Test Code	CPT*	Reflex Criteria
Syphilis Screen w/reflex RPR w/reflex Titer or TP-PA (Syphilis Total IgG/IgM Screen)	905363	Screen: 86780 RPR Reflex: 86592 Titer Reflex: 86593 TP-PA Reflex: 86780	If screen is reactive RPR will be performed at an additional charge. If RPR is positive Titer will be performed at an additional charge. If RPR is nonreactive TP-PA will be performed at an additional charge.  Please refer to the testing algorithm on the reverse of this document.
Syphilis Treponemal Screen	905359	86780	No reflexes
RPR w/reflex to Titer and TP-PA	1054	RPR: 86592 Titer Reflex: 86593 TP-PA Reflex: 86780	If RPR is positive Titer and TP-PA will be performed at an additional charge.  Please refer to the testing algorithm on the reverse of this document.
RPR w/reflex to Titer	5376	RPR: 86592 Titer Reflex: 86593	If RPR is positive Titer will be performed at an additional charge.
Treponema Pallidum Ab - PA (TP-PA)	900780	86780	No reflexes

## Recommended Risk-Based Testing

### Low Risk Patients and/or Patients with Latent or Late Syphilis


Test Code 1054 - RPR w/reflex to Titer and TP-PA is recommended

### High Risk Patients or when Early Syphilis Infection is Suspected

Test Code 905363 - Syphilis Screen w/reflex RPR w/reflex Titer or TP-PA (Syphilis Total IgG/IgM Screen) is recommended

Tests on this chart may change periodically.

**Low Risk Patients and/or Patients with Latent or Late Syphilis:  
Test 1054 - RPR w/reflex to Titer and TP-PA**

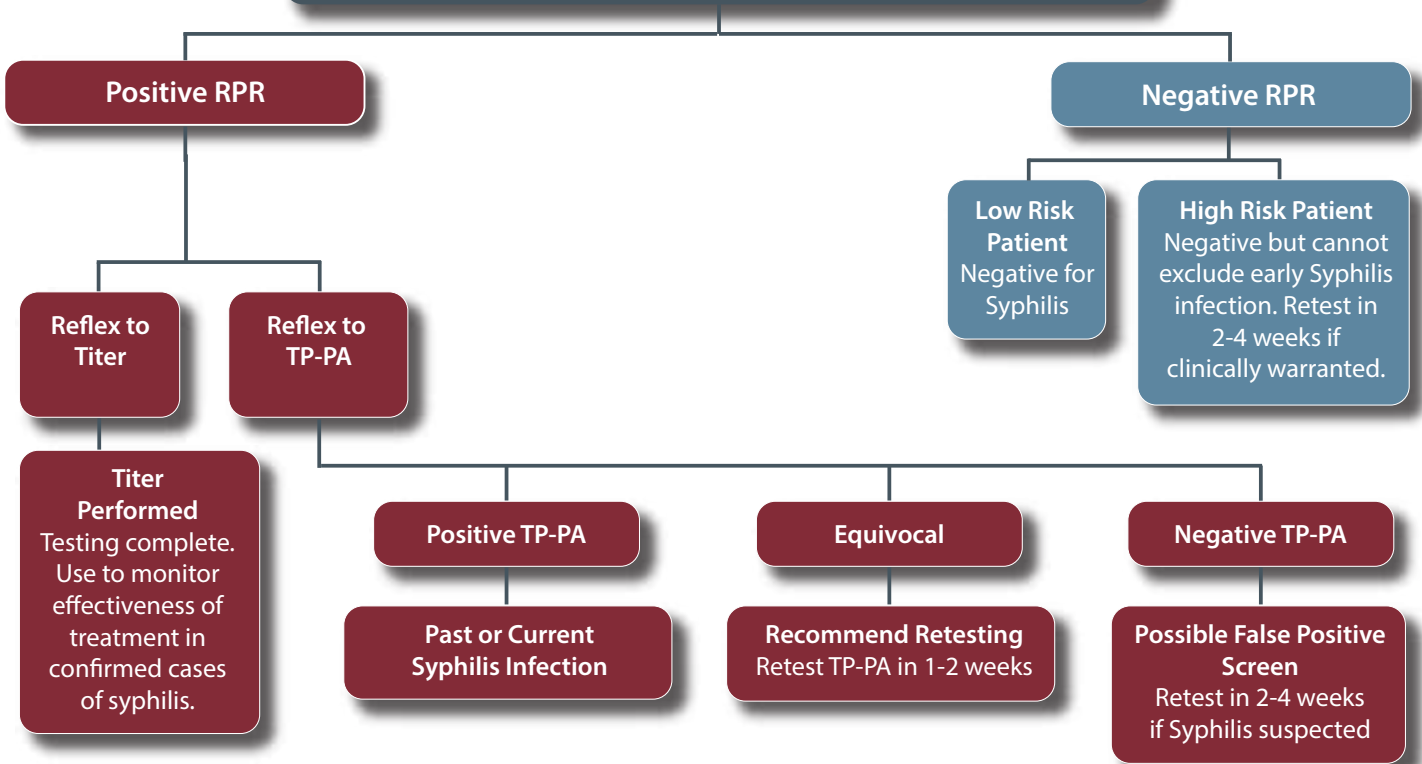

**High Risk Patients or when Early Syphilis Infection is Suspected:  
Test 905363 - Syphilis Screen w/reflex RPR w/reflex Titer or TP-PA  
(Syphilis Total IgG/IgM Screen)**

